


ANNUAL WATER QUALITY REPORT

WATER TESTING
PERFORMED
IN 2014

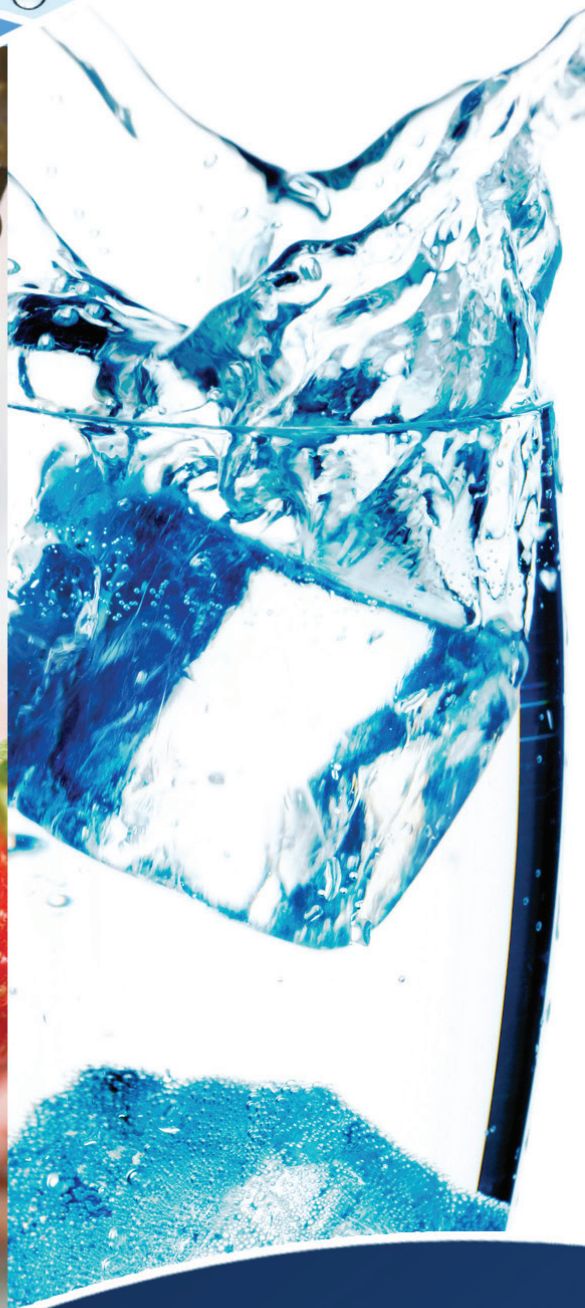

Presented By
Plymouth Water Division

PWS ID#: 4239000

Our Mission Continues

We are proud to present once again our annual water quality report covering all testing performed between January 1 and December 31, 2014. Most notably, last year marked the 40th anniversary of the Safe Drinking Water Act (SDWA). This rule was created to protect public health by regulating the nation's drinking water supply. We celebrate this milestone as we continue to manage our water system with a mission to deliver the best quality drinking water. By striving to meet the requirements of SDWA, we are ensuring a future of healthy, clean drinking water for years to come.


Please let us know if you ever have any questions or concerns about your water.

How Long Can I Store Drinking Water?

The disinfectant in drinking water will eventually dissipate even in a closed container. If that container housed bacteria prior to filling up with the tap water the bacteria may continue to grow once the disinfectant has dissipated. Some experts believe that water could be stored up to six months before needing to be replaced. Refrigeration will help slow the bacterial growth.

Important Health Information

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants may be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. The U.S. EPA/CDC (Centers for Disease Control and Prevention) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline at (800) 426-4791 or <http://water.epa.gov/drink/hotline>.

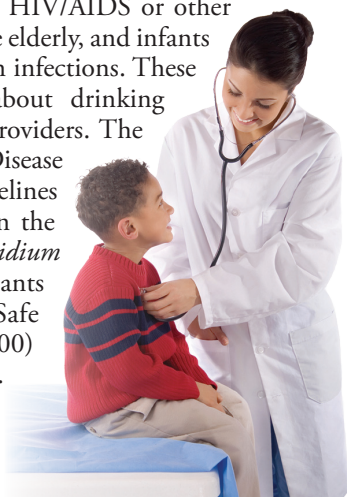

Water Conservation

You can play a role in conserving water and saving yourself money in the process by becoming conscious of the amount of water your household is using and by looking for ways to use less whenever you can. It is not hard to conserve water. Here are a few tips:

- Automatic dishwashers use 15 gallons for every cycle, regardless of how many dishes are loaded. So get a run for your money and load it to capacity.
- Turn off the tap when brushing your teeth.
- Check every faucet in your home for leaks. Just a slow drip can waste 15 to 20 gallons a day. Fix it and you can save almost 6,000 gallons per year.
- Check your toilets for leaks by putting a few drops of food coloring in the tank. Watch for a few minutes to see if the color shows up in the bowl. It is not uncommon to lose up to 100 gallons a day from an invisible toilet leak. Fix it and you save more than 30,000 gallons a year.
- Use your water meter to detect hidden leaks. Simply turn off all taps and water using appliances. Then check the meter after 15 minutes. If it moved, you have a leak.

QUESTIONS?

For more information about this report, or for any questions relating to your drinking water, please call Mark Cloud, Plymouth Water Division Water Quality Manager, at (508) 830-4162 x141.

What's Your Water Footprint?

You may have some understanding about your carbon footprint, but how much do you know about your water footprint? The water footprint of an individual, community, or business is defined as the total volume of freshwater that is used to produce the goods and services that are consumed by the individual or community or produced by the business. For example, 11 gallons of water are needed to irrigate and wash the fruit in one half-gallon container of orange juice. Thirty-seven gallons of water are used to grow, produce, package, and ship the beans in that morning cup of coffee. Two hundred and sixty-four gallons of water are required to produce one quart of milk, and 4,200 gallons of water are required to produce two pounds of beef.

According to the U.S. EPA, the average American uses over 180 gallons of water daily. In fact, in the developed world, one flush of a toilet uses as much water as the average person in the developing world allocates for an entire day's cooking, washing, cleaning, and drinking. The annual American per capita water footprint is about 8,000 cubic feet; twice the global per capita average. With water use increasing six-fold in the past century, our demands for freshwater are rapidly outstripping what the planet can replenish.

To check out your own water footprint, go to www.gracelinks.org/824/water-program or visit www.waterfootprint.org to see how the water footprints of other nations compare.

To The Last Drop

The National Oceanic and Atmospheric Administration (NOAA) defines drought as a deficiency in precipitation over an extended period of time, usually a season or more, resulting in a water shortage causing adverse impacts on vegetation, animals, and/or people. Drought strikes in virtually all climate zones, from very wet to very dry.

There are primarily three types of drought: Meteorological Drought refers to the lack of precipitation, or the degree of dryness and the duration of the dry period; Agricultural Drought refers to the agricultural impact of drought, focusing on precipitation shortages, soil water deficits, and reduced ground water or reservoir levels needed for irrigation; and Hydrological Drought, which pertains to drought that usually occurs following periods of extended precipitation shortfalls that can impact water supply (i.e., stream flow, reservoir and lake levels, ground water).

Drought is a temporary aberration from normal climatic conditions, thus it can vary significantly from one region to another. Although normally occurring, human factors, such as water demand, can exacerbate the duration and impact that drought has on a region. By following simple water conservation measures, you can help significantly reduce the lasting effects of extended drought.

To learn more about water conservation efforts, check out U.S. EPA's Water Conservation Tips for Residents at: www.epa.gov/region1/eco/drinkwater/water_conservation_residents.html.

Tap vs. Bottled

Thanks in part to aggressive marketing, the bottled water industry has successfully convinced us all that water purchased in bottles is a healthier alternative to tap water. However, according to a four-year study conducted by the Natural Resources Defense Council, bottled water is not necessarily cleaner or safer than most tap water. In fact, about 25 percent of bottled water is actually just bottled tap water (40 percent according to government estimates).

The Food and Drug Administration is responsible for regulating bottled water, but these rules allow for less rigorous testing and purity standards than those required by the U.S. EPA for community tap water. For instance, the high mineral content of some bottled waters makes them unsuitable for babies and young children. Further, the FDA completely exempts bottled water that's packaged and sold within the same state, which accounts for about 70 percent of all bottled water sold in the United States.

People spend 10,000 times more per gallon for bottled water than they typically do for tap water. If you get your recommended eight glasses a day from bottled water, you could spend up to \$1,400 annually. The same amount of tap water would cost about 49 cents. Even if you installed a filter device on your tap, your annual expenditure would be far less than what you'd pay for bottled water.

For a detailed discussion on the NRDC study results, check out their Web site at www.nrdc.org/water/drinking/bw/exesum.asp.



Where Does My Water Come From?

The Town of Plymouth's municipal water supply consists of two aquifers and 12 gravel-packed wells at 10 locations throughout Plymouth. The Plymouth Water Division spends more than \$60,000 annually testing its water to ensure water quality to continue its mission to provide the highest quality drinking water and fire protection at the lowest possible cost to the ratepayers. The Plymouth water system serves the entire northern section of town between Federal Furnace Road and the Kingston and Carver boundaries; Plymouth Center; Chiltonville; Manomet; and Cedarville areas east of Route 3 south to the Bourne town line.

Source Water Assessment

A Source Water Assessment Plan (SWAP) is now available at our office. This plan is an assessment of the delineated area around our listed sources through which contaminants, if present, could migrate and reach our source water. It also includes an inventory of potential sources of contamination within the delineated area, and a determination of the water supply's susceptibility to contamination by the identified potential sources.

According to the SWAP, our water system had a susceptibility rating of medium. If you would like to review the SWAP, please feel free to contact our office during regular office hours.

Water Main Flushing

Distribution mains (pipes) convey water to homes, businesses, and hydrants in your neighborhood. The water entering distribution mains is of very high quality; however, water quality can deteriorate in areas of the distribution mains over time. Water main flushing is the process of cleaning the interior of water distribution mains by sending a rapid flow of water through the mains.

Flushing maintains water quality in several ways. For example, flushing removes sediments like iron and manganese. Although iron and manganese do not pose health concerns, they can affect the taste, clarity, and color of the water. Additionally, sediments can shield microorganisms from the disinfecting power of chlorine, contributing to the growth of microorganisms within distribution mains. Flushing helps remove stale water and ensures the presence of fresh water with sufficient dissolved oxygen, disinfectant levels, and an acceptable taste and smell.

During flushing operations in your neighborhood, some short-term deterioration of water quality, though uncommon, is possible. You should avoid tap water for household uses at that time. If you do use the tap, allow your cold water to run for a few minutes at full velocity before use and avoid using hot water, to prevent sediment accumulation in your hot water tank.

Please contact us if you have any questions or if you would like more information on our water main flushing schedule.

Monitoring For Manganese

Manganese is naturally occurring mineral in our area. We sequester manganese at three of our wells from the groundwater sources; Federal Furnace Well, Lout Pond Well, and Wannos Pond Well.

The maximum contaminant level for manganese set by the Department of Environmental Protection (DEP) is 50 ppb (parts per billion); for Massachusetts, see 310 CMR 22.07 D.

A revised Health Advisory adopted by the DEP has set the limits as follows:

Target population	Exposure Period	Health Advisory
General population	Lifetime	300 ppb
General population	10 days	1,000 ppb
Infants/children <1 year old	<10 days	300 ppb

Note: At manganese concentrations greater than 300 ppb parents are advised to use bottled or treated water for their children, in particular to make formula.

Results before sequestering:

- Federal Furnace Well Raw Water has a manganese level of 200 ppb.
- Lout Pond Well Raw Water has a manganese level 37 ppb.
- Wannos Well Raw Water has a manganese level 37 ppb.

We continue to monitor the distribution sites in these pressure zones for elevated levels of manganese.

Lead in Home Plumbing

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. We are responsible for providing high-quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at www.epa.gov/safewater/lead.

Substances That Could Be in Water

To ensure that tap water is safe to drink, the Department of Environmental Protection (DEP) and the U.S. Environmental Protection Agency (U.S. EPA) prescribes regulations limiting the amount of certain contaminants in water provided by public water systems. The Food and Drug Administration (FDA) and Massachusetts Department of Public Health (DPH) regulations establish limits for contaminants in bottled water, which must provide the same protection for public health. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of these contaminants does not necessarily indicate that the water poses a health risk.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Substances that may be present in source water include:

Microbial Contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, or wildlife;

Inorganic Contaminants, such as salts and metals, which can be naturally occurring or may result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming;

Pesticides and Herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses;

Organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and which may also come from gas stations, urban stormwater runoff, and septic systems;

Radioactive Contaminants, which can be naturally occurring or may be the result of oil and gas production and mining activities.

More information about contaminants and potential health effects can be obtained by calling the U.S. EPA's Safe Drinking Water Hotline at (800) 426-4791.

What's a Cross-connection?

Cross-connections that contaminate drinking water distribution lines are a major concern. A cross-connection is formed at any point where a drinking water line connects to equipment (boilers), systems containing chemicals (air conditioning systems, fire sprinkler systems, irrigation systems) or water sources of questionable quality. Cross-connection contamination can occur when the pressure in the equipment or system is greater than the pressure inside the drinking water line (backpressure). Contamination can also occur when the pressure in the drinking water line drops due to fairly routine occurrences (main breaks, heavy water demand) causing contaminants to be sucked out from the equipment and into the drinking water line (backsiphonage).

Outside water taps and garden hoses tend to be the most common sources of cross-connection contamination at home. The garden hose creates a hazard when submerged in a swimming pool or when attached to a chemical sprayer for weed killing. Garden hoses that are left lying on the ground may be contaminated by fertilizers, cesspools or garden chemicals. Improperly installed valves in your toilet could also be a source of cross-connection contamination.

Community water supplies are continuously jeopardized by cross-connections unless appropriate valves, known as backflow prevention devices, are installed and maintained. We have surveyed industrial, commercial, and institutional facilities in the service area to make sure that potential cross-connections are identified and eliminated or protected by a backflow preventer. We also inspect and test backflow preventers to make sure that they are providing maximum protection.

For more information, review the Cross-Connection Control Manual from the U.S. EPA's Web site at <http://water.epa.gov/infrastructure/drinkingwater/pws/crossconnectioncontrol/index.cfm>. You can also call the Safe Drinking Water Hotline at (800) 426-4791.



When was drinking water first regulated?

The Safe Drinking Water Act (SDWA) of 1974 represents the first time that public drinking water supplies were protected on a federal (national) level in the U.S. Amendments were made to the SDWA in 1986 and 1996.

How much water do we use every day?

The average person in the U.S. uses 80 to 100 gallons of water each day. (During medieval times, a person used only 5 gallons per day.) It takes 2 gallons to brush your teeth, 2 to 7 gallons to flush a toilet, and 25 to 50 gallons to take a shower.

When was chlorine first used in the U.S.?

In 1908, Jersey City, New Jersey, and Chicago, Illinois, were the first water supplies to be chlorinated in the U.S.

Seventy-one percent of Earth is covered in water: how much is drinkable?

Oceans hold about 96.5 percent of all Earth's water. Only three percent of the Earth's water can be used as drinking water. Seventy-five percent of the world's fresh water is frozen in the polar ice caps.

How much water is in our atmosphere?

Forty trillion gallons of water are carried in the atmosphere across the U.S. each day.

How much water is in our bodies?

Water makes up almost two-thirds of the human body and 70 percent of the brain. Four hundred gallons of water are recycled through our kidneys each day.

How long can a person go without water?

Although a person can live without food for more than a month, a person can live without water for only approximately one week.

Is tap water cheaper than soda?

Yes! You can refill an 8 oz. glass of tap water approximately 15,000 times for the same cost as a six-pack of soda pop. And water has no sugar or caffeine.

Sampling Results

During the past year we have taken hundreds of water samples in order to determine the presence of any radioactive, biological, inorganic, volatile organic or synthetic organic contaminants. The table below shows only those contaminants that were detected in the water. The state requires us to monitor for certain substances less than once per year because the concentrations of these substances do not change frequently. In these cases, the most recent sample data are included, along with the year in which the sample was taken.

REGULATED SUBSTANCES

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	MCL [MRDL]	MCLG [MRDLG]	AMOUNT DETECTED	RANGE LOW-HIGH	VIOLATION	TYPICAL SOURCE
Barium (ppm)	2014	2	2	0.050	0.003–0.050	No	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits
Nitrate (ppm)	2014	10	10	2.37	0.07–2.37	No	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits
TTHMs [Total Trihalomethanes]–Stage 2 (ppb)	2014	80	NA	19.9	4.03–19.9	No	By-product of drinking water disinfection

Tap water samples were collected for lead and copper analyses from sample sites throughout the community

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	AL	MCLG	AMOUNT DETECTED (90TH%TILE)	SITES ABOVE AL/TOTAL SITES	VIOLATION	TYPICAL SOURCE
Copper (ppm)	2013	1.3	1.3	0.084	0/30	No	Corrosion of household plumbing systems; Erosion of natural deposits
Lead (ppb)	2013	15	0	0.0056	0/30	No	Corrosion of household plumbing systems; Erosion of natural deposits

SECONDARY SUBSTANCES

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	SMCL	MCLG	AMOUNT DETECTED	RANGE LOW-HIGH	VIOLATION	TYPICAL SOURCE
Aluminum (ppm)	2014	200	NA	0.04	0.02–0.04	No	Erosion of natural deposits; Residual from some surface water treatment processes
Chloride (ppm)	2014	250	NA	144	11.5–144	No	Runoff/leaching from natural deposits
Copper (ppm)	2014	1.0	NA	0.025	.003–0.025	No	Corrosion of household plumbing systems; Erosion of natural deposits
Iron (ppb)	2014	300	NA	0.24	0.01–0.24	No	Leaching from natural deposits; Industrial wastes
Manganese ¹ (ppb)	2014	50	NA	210	8–210	No	Leaching from natural deposits
Sulfate (ppm)	2014	250	NA	9.1	4.8–9.1	No	Runoff/leaching from natural deposits; Industrial wastes
Zinc (ppm)	2014	5	NA	0.033	0.012–0.033	No	Runoff/leaching from natural deposits; Industrial wastes

UNREGULATED SUBSTANCES²

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	AMOUNT DETECTED	RANGE LOW-HIGH	TYPICAL SOURCE
Sodium (ppm)	2014	70.5	12.9–70.5	Road runoff and corrosion control chemical

¹ Manganese is a naturally occurring mineral found in rocks, soil and groundwater, and surface water. Manganese is necessary for proper nutrition and is part of a healthy diet, but can have undesirable effects on certain sensitive populations at elevated concentrations. MADEP has set a health advisory limit for manganese at 300 ppb.

² Unregulated contaminants are those for which the U.S. EPA has not established drinking water standards. The purpose of unregulated contaminant monitoring is to assist U.S. EPA in determining their occurrence in drinking water and whether future regulation is warranted.

Definitions

90th Percentile: Out of every 10 homes sampled, 9 were at or below this level.

AL (Action Level): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

MCL (Maximum Contaminant Level): The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG (Maximum Contaminant Level Goal): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

MRDL (Maximum Residual Disinfectant Level): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

MRDLG (Maximum Residual Disinfectant Level Goal): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

NA: Not applicable

ND (Not detected): Indicates that the substance was not found by laboratory analysis.

ppb (parts per billion): One part substance per billion parts water (or micrograms per liter).

ppm (parts per million): One part substance per million parts water (or milligrams per liter).